

ANEXA 2

Fig.1

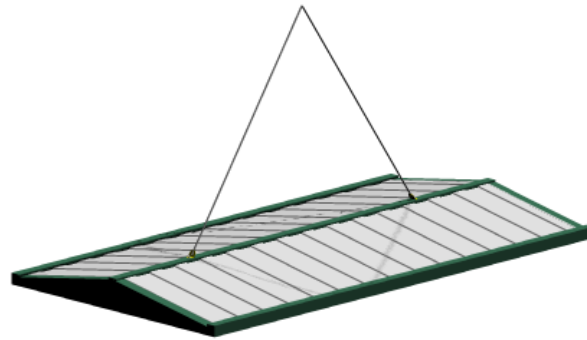


Fig.2

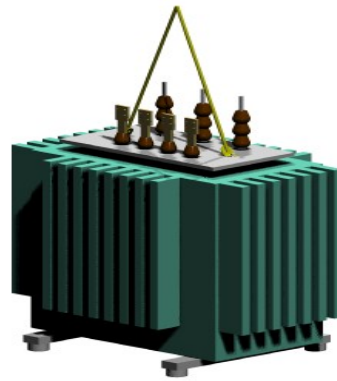


Fig.3


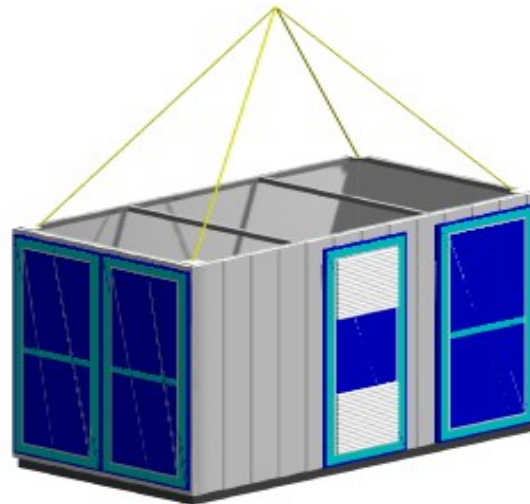


Fig.4

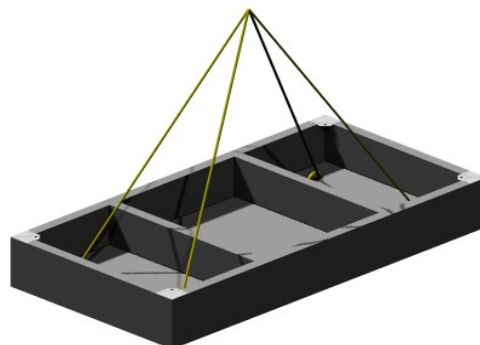

ANEXA 2 - PTP \leq 630kVA



fig.1

ANEXA 2 - PTP \geq 800 kVA

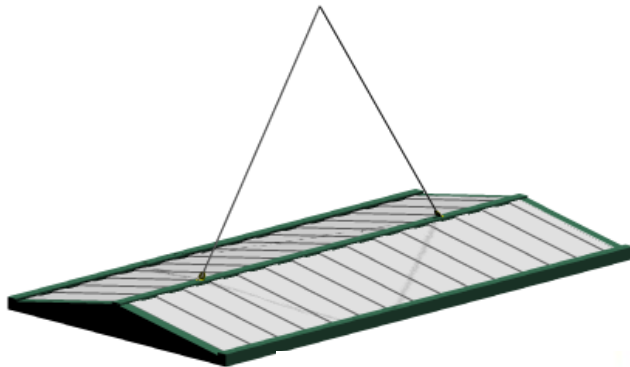


fig.2

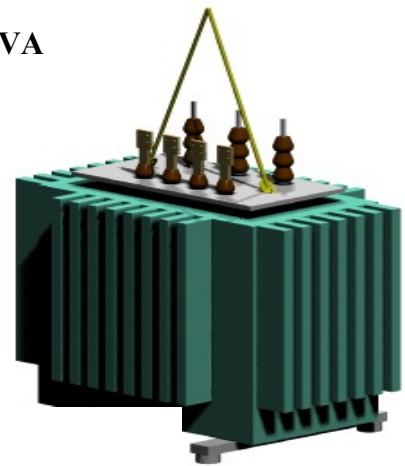


fig.3

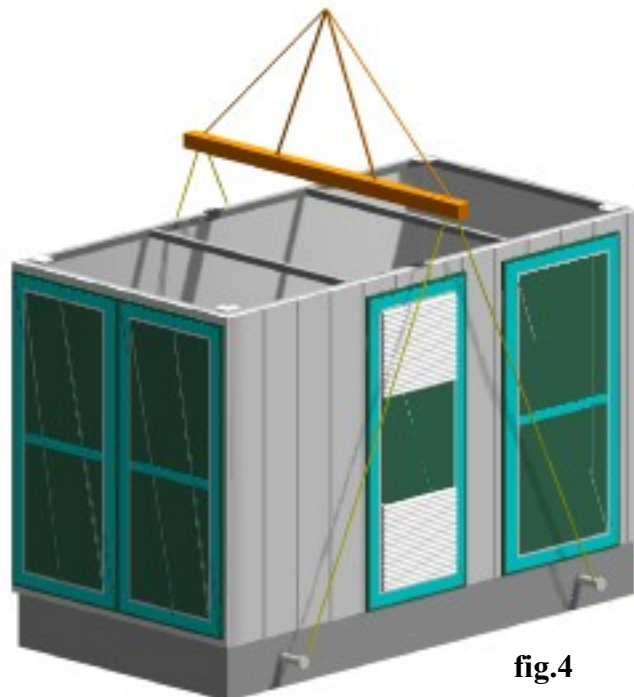


fig.4

- automacara

Dispozitive :

- trusa de verificat cabluri cu tensiune inalta
- trusa de curent –1200A
- cleste ampermetric
- megaohmmetru 5000V
- voltmetru
- aparat de verificat prize de pamant
- indicator de prezenta tensiune pe JT si MT

Scule :

- presa hidraulica pentru taiat cable
- presa hidraulica pentru sertizat papuci 10 – 240mm²
- dispozitiv de decojit cable
- trusa de chei fixe, tubulare, inelare, trusa electrician

Verificat,
Director tehnic – ing. RADU PETRU

Intocmit,
Viorica Radu-ing. APE

PEROM BACAU

Str. Republicii 166;
Telefon:
Fax :
e-mail :

cod: 600303
0234 / 574344
0234 / 573548
office@ perom.

ANEXA 2

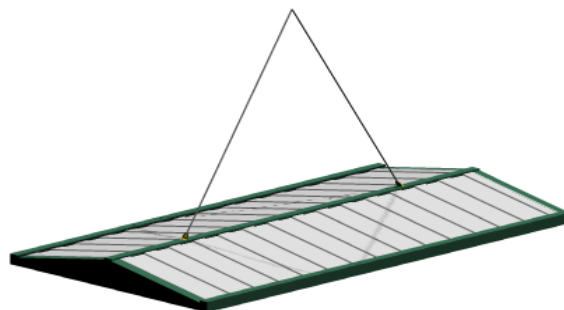


fig.1

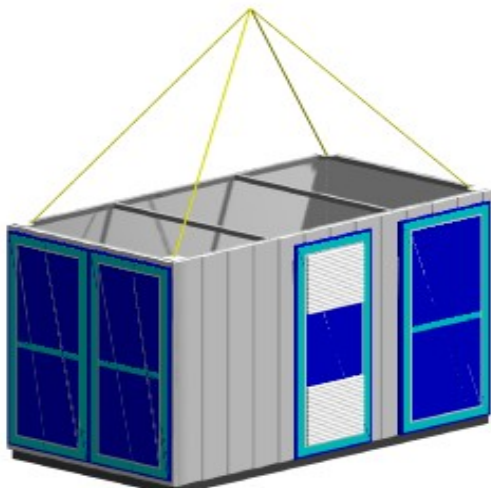


fig.2

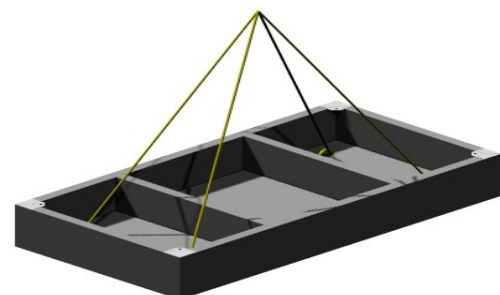


fig.3